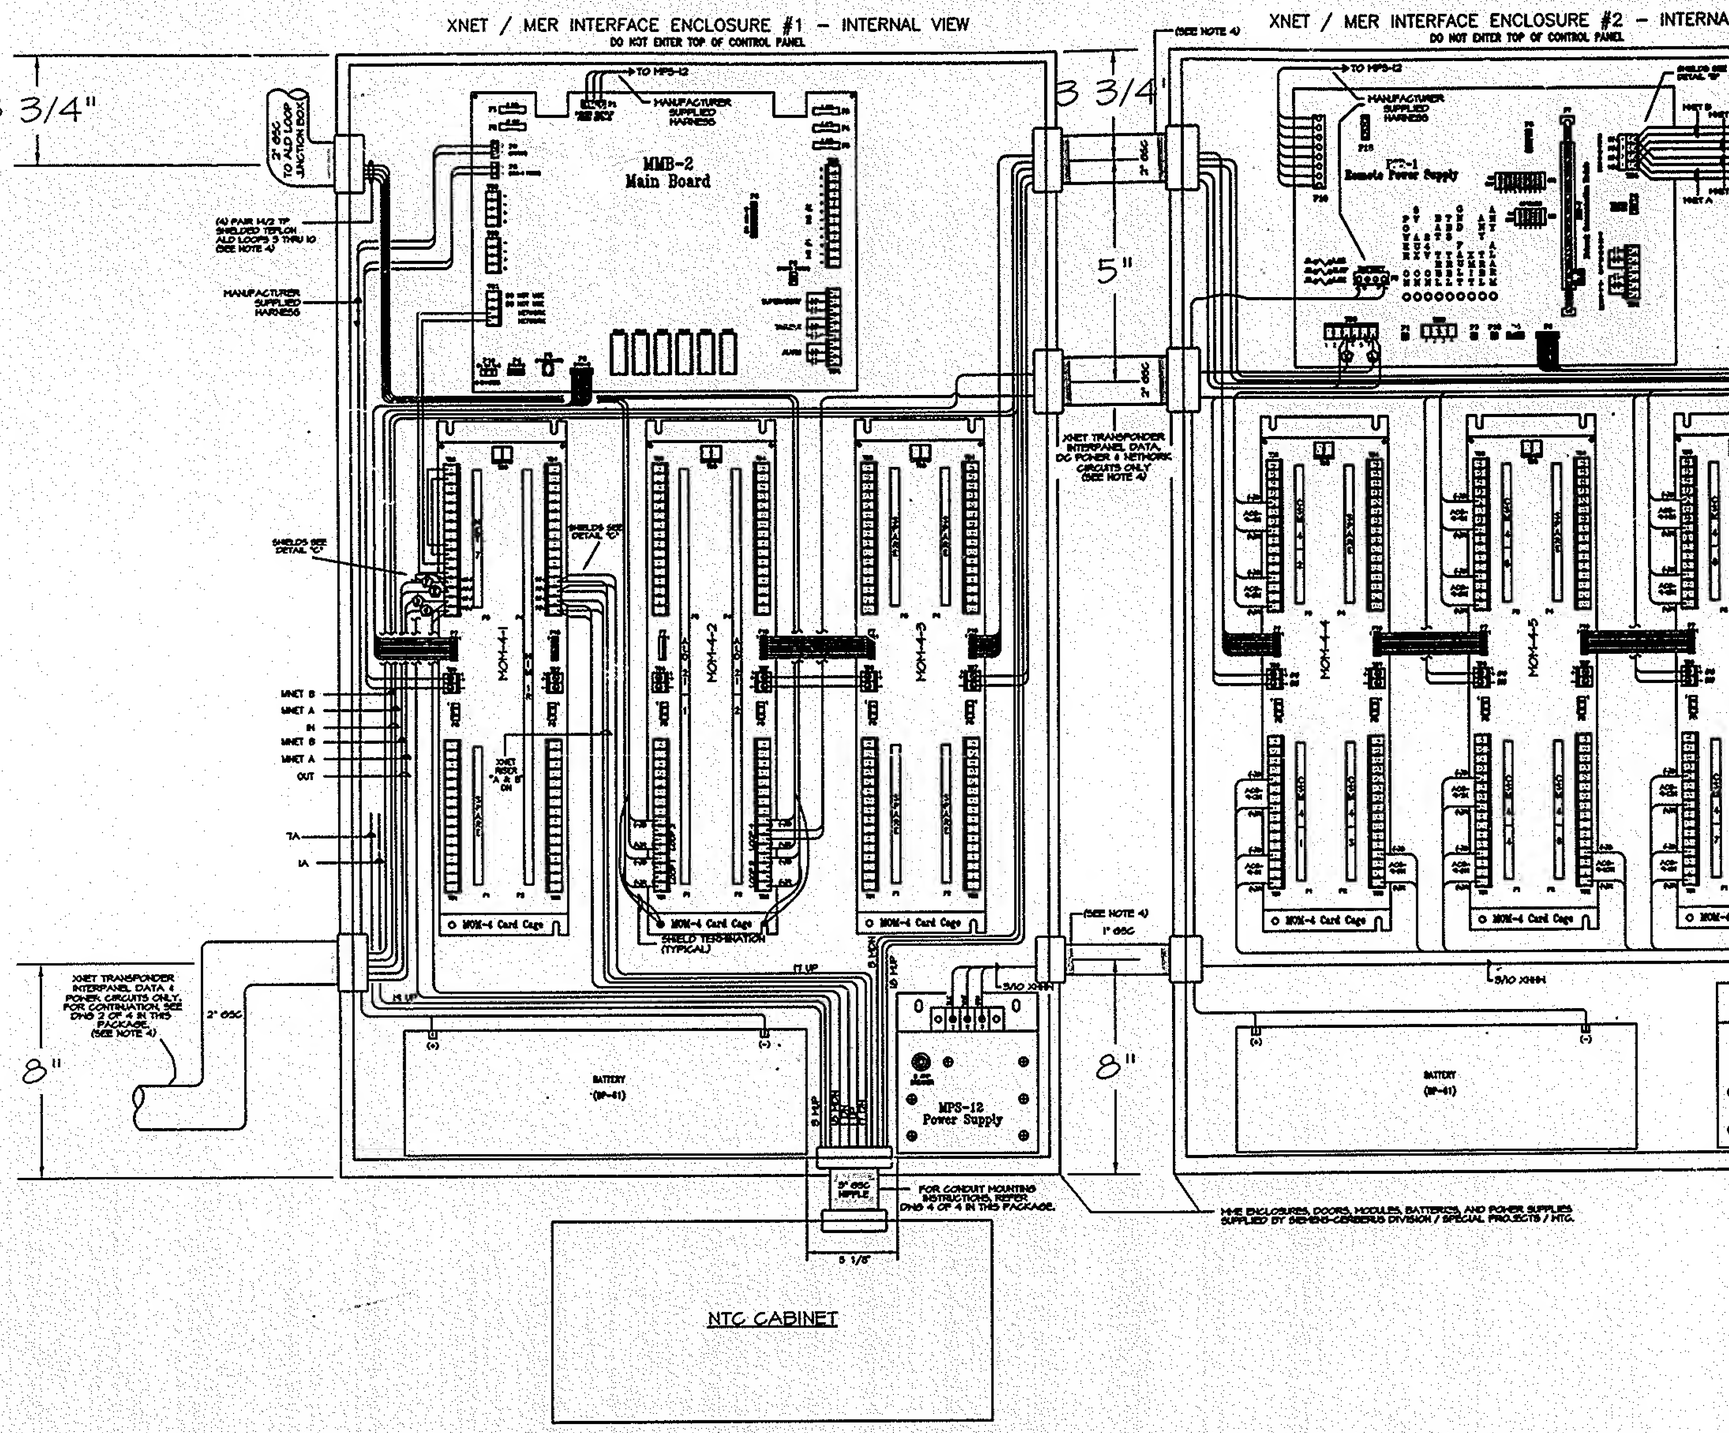

	NOTES	NOTES
	ALL MATERIALS UTILIZED SHALL BE APPROVED FOR USE BY THE ENGINEER. GROUNDING & BONDING REQUIRED - REFER TO P/A DRAWINGS. AC POWER WIRING SHALL BE #10 AWG (WHITE/NEUTRAL, BLACK/HOT, GREEN/GROUND) PER P/A SPECIFICATIONS & DRAWINGS. CONTROL & AUDIO SPEAKER CONTROL & SOLENOID CIRCUITS SHALL BE UNSHIELDED UNLESS PAIRED WITH TEFLON PER P/A SPECIFICATIONS & DRAWINGS. LOW LEVEL AUDIO NETWORK AND STROBE SYNCHRONIZATION CIRCUITS SHALL BE SHIELDED UNLESS PAIRED WITH TEFLON PER P/A SPECIFICATIONS & DRAWINGS. ALL WIRING, DEVICES, TERMINALS, CONNECTORS ETC. SHALL BE UL LISTED FOR THE USE WITH WHICH USED AND IN CONFORMANCE WITH P/A SPECIFICATIONS. NO WIRING OR PARTS ABOVE 24 VOLTS ARE TERMINAL FOR CONNECTION USE FARPOINT MODEL # END-M-ID TERMINAL # FARPOINT MODEL # GT-950 CONTROLLED CYCLE INSTALLATION #00.	1. ALL WIRING TO BE INSTALLED IN ACCORDANCE WITH LOCAL CODES, ORDINANCES, AUTHORITIES HAVING JURISDICTION AND THE NATIONAL ELECTRICAL CODE. ANY DISCREPANCIES ARE TO BE REPORTED IMMEDIATELY TO THE CERBERUS ENGINEERING DEPARTMENT AND THE FARPOINT PROJECT ENGINEER. INSTALLING CONTRACTOR SHALL NOT PROCEED WITH CLARIFICATIONS AND RESOLUTIONS. ALL WIRING SHALL BE INSTALLED IN CONDUIT, ENCLOSURES AND RACEWAYS AS REQUIRED BY LOCAL CODES AND AUTHORITIES HAVING JURISDICTION. ALL WIRING SHALL BE FREE FROM GROUNDS, OPENS, SHORTS AND IMPROPER POLARITY. ALL WIRING SHALL BE TESTED AND VERIFIED AS SUCH BEFORE CONNECTION TO ANY EQUIPMENT. ALL WIRING SHALL BE PROPERLY TERMINATED IN CABINETS, PANELS AND JUNCTION BOXES. ALL SPARE CONDUCTORS SHALL BE TERMINATED AND LABELED AS SPARES. 2. ALL EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. ANY DEVIATIONS FROM THESE INSTRUCTIONS SHALL BE APPROVED BY THE CERBERUS ENGINEERING DEPARTMENT.

FILE NAME: D:\DWG\NE-PROJ\X-PONDER\MS floor scope specs and transponder\with power supply\xp-ms3-1.dwg plotted on 3/5/1998 by hutson